


Detailblatt 24-932  
 Dämmung Wand 24-400: 60 + 120 + 60mm  
 Psi-Wert

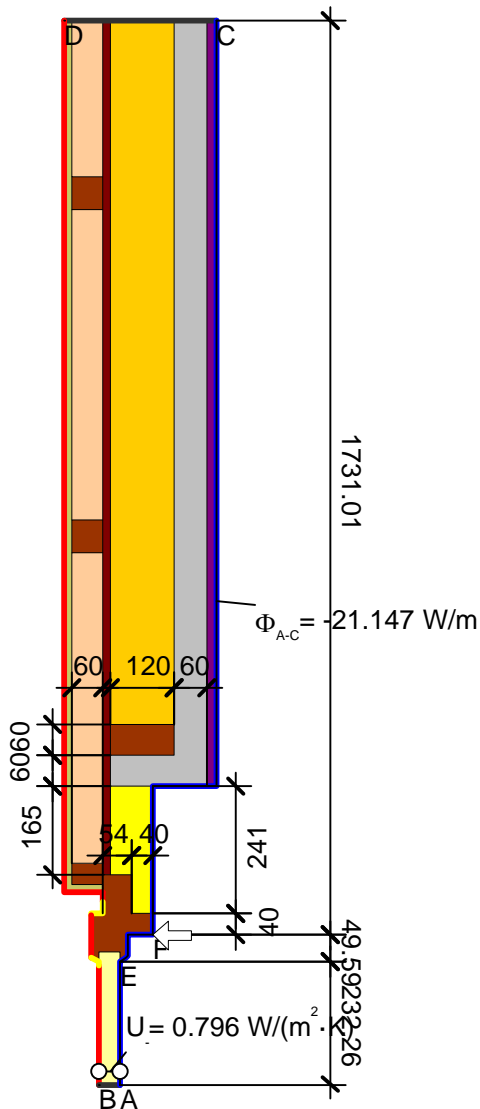



$$\Psi_{A-F,C,*} = \frac{\Phi}{\Delta T} - U_1 \cdot b_1 - U_2 \cdot b_2 - U_3 \cdot b_3 = \frac{21.147}{34.600} - 0.796 \cdot 0.232 - 0.150 \cdot 1.731 - 1.400 \cdot 0.050 = 0.10 \text{ W}/(\text{m} \cdot \text{K})$$

Material	$\lambda$ [W/(m·K)]
Aussenputz	0.870
Fichte, Tanne	0.140
Gips	0.400
Holzspanplatte 600	0.110
ISOVER ISOCONFORT 032	0.032
ISOVER ISOLENE P	0.032
ISOVER ISOPONTE	0.032
ISOVER SPARRENPLATTE 032 PR	0.032
Maske	0.035
Unbelüftete Hohlräume	Eps=0.9/0.9

Randbedingung	$q$ [W/m <sup>2</sup> ]	$\theta$ [°C]	$R$ [(m <sup>2</sup> ·K)/W]	$\epsilon$
Aussen Standard		-14.600	0.040	
Innen Fensterrahmen Reduziert		20.000	0.200	
Innen Fensterrahmen Standard		20.000	0.130	
Innen Standard		20.000	0.130	
Symmetrie/Bauteilschnitt	0.000			

ISOVER Bautechnik, August 2013

Detailblatt 24-932  
Dämmung Wand 24-400: 60 + 120 + 60mm  
Psi-Wert

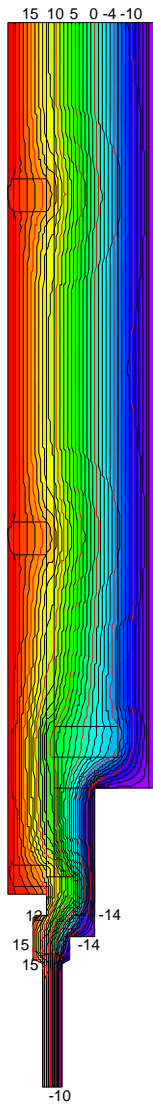

ISOVER Bautechnik, August 2013