


Detailblatt 24-925
 Dämmung Wand 24-110: 60 + 120 + 60mm
 Kriterium Schimmel

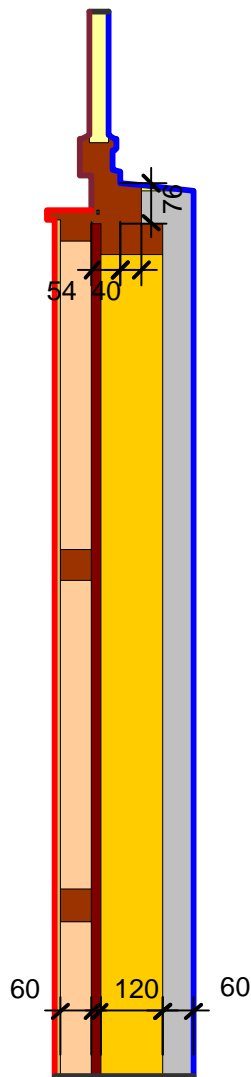


Material	λ [W/(m·K)]	Randbedingung	q [W/m ²]	θ [°C]	R [(m ² ·K)/W]	ϵ
Fichte, Tanne	0.140	Aussen Standard		8.400		0.040
Gips	0.400	Innen Fenster/Türen		20.000		0.150
Holzspanplatte 600	0.110	Innen Untere Raumhälfte		20.000		0.350
ISOVER ISOCONFORT 032	0.032	Symmetrie/Bauteilschnitt	0.000			
ISOVER ISOLENE P	0.032					
ISOVER ISOPONTE	0.032					
ISOVER SPARRENPLATTE 032 PR	0.032					
Maske	0.035					
Unbelüftete Hohlräume	Eps=0.9/0.9					

ISOVER Bautechnik, August 2013

Detailblatt 24-925
Dämmung Wand 24-110: 60 + 120 + 60mm
Kriterium Schimmel



$\theta_{si \min_A} = 17.41 \text{ }^\circ\text{C}$
 $f_{R_{si}} = 0.777$
 $\varphi_{si(50\%)} = 59\%$
 $\varphi_{80\%} = 68\%$



ISOVER Bautechnik, August 2013